

STUDY OF THERMODYNAMIC OPTIMIZATION CRITERIA FOR DOMESTIC REFRIGERATOR (PROPANE –BUTANE AS DIVERSE REFRIGERANT)

N.AUSTIN¹, P.SENTHILKUMAR² & N.KANTHAVELKUMARAN³

¹Research Scholar, Sathyabama University, Chennai, Tamilnadu, India

²Professor, KSR College of Engineering & Technology, Thirucenkode, Tamilnadu, India

³Associate Professor, Arunachala College of Engineering for Women, Vellichanthalai, KK Dist – 629203, India

ABSTRACT

A domestic refrigerator designed to work with R-134a was used as an investigation unit to assess the prospect of using diverse refrigerants. The recitation of the refrigerator using diverse refrigerant was investigated and compared with the performance of refrigerator when R-134a was used as refrigerant. The effect of condenser temperature and evaporator temperature on COP, refrigerating effect was investigated. The energy consumption of the refrigerator during experiment with diverse refrigerant and R-134a was measured. The result shows the permanent running and cycling results showed that R134a with a charge of 100 g or diverse (mixed) refrigerant with charge of 80 mg or more satisfy the necessary freezer air temperature of -12°C . The lowest electric energy consumption was achieved using diverse refrigerant with heat level is less than -15°C . This mixture achieved higher volumetric cooling capacity and lower freezer air temperature compared to R134a. Experimental results of the refrigerator using diverse refrigerant were compared with those using R134a. Pull-down time, pressure ratio and power consumption of diverse refrigerant refrigerator was under those of R134a refrigerator by about 7.6%, 5.5% and 4.3%, respectively. Also, actual COP of diverse refrigerant refrigerator was higher than that of R134a by about 7.6%. Lower on-time ratio and energy consumption of diverse refrigerant refrigerator by nearly 14.3% and 10.8%, respectively, compared to those of R134a refrigerator were achieved. The COP and other result obtain in this experiment show a positive indication of using diverse refrigerant as refrigerants in domestic refrigerator.

KEY WORDS: Energy Consumption, R134a Diverse Refrigerant, Chlorofluoro Carbons, Propane, Butane, Isobutane, COP

INTRODUCTION

Common frost was dispersed and used in both commercial and dwelling application in the middle-1800s to refrigerate food. The suggestion that cold could be produced by the forced evaporation of a impulsive liquid under reduced pressure had been previously pursued by Willam Cullen in the eighteenth century. A refrigerator is a cooling appliance comprising a thermally insulated screened-off area and a heat pump - element or perfunctory means - to transfer heat from it to the external atmosphere cooling the contents to a temperature below ambient. Refrigerators are extensively used to store foods which deteriorate at ambient temperatures; spoilage from bacterial growth and other processes is much slower at low temperatures. An apparatus described as a "refrigerator" maintains a temperature a slight degrees above the freezing point of water; a similar device which maintain a temperature below the freezing point of water is called a "freezer." The refrigerator is a fairly modern invention among kitchen appliances. It replaced the icebox, which had been a common domestic appliance for almost a century and a half earlier. For this explanation, a refrigerator is sometimes referred to as an "ice box". Freezers keep their contents frozen. They are used in domestics and in industry and commerce. Most freezers operate around -18°C (0°F). Domestic freezers can be included as a separate compartment in a refrigerator, or can be a

separate appliance. Domestic freezers are generally standing units resembling refrigerators, or chests resembling upright units lay on their backs. Many standing modern freezers come with an ice slot machine built into their door. Chlorofluorocarbons (CFCs) and hydro chlorofluorocarbons (HCFCs) have many suitable properties, for example, non flammability, low toxicity and material compatibility that have led to their common widespread use by both consumers and industries around the world, especially as refrigerants in air conditioning and refrigerating systems. Results from many researches show that this ozone layer is being depleted.

The general consensus for the cause of this event is that free chlorine radicals remove ozone from the atmosphere, and later, chlorine atoms continue to convert more ozone to oxygen. The presence of chlorine in the stratosphere is the result of the migration of chlorine containing chemicals. The chlorofluorocarbons (CFCs) and hydro chlorofluorocarbons (HCFCs) are a large class of chemicals that behave in this manner. (Radermacher and Kim, 1996, Akash and Said, 2003). Hydrocarbon particularly propane, butane and isobutene are proposed as an environment benign refrigerant. Hydrocarbons are free from ozone depletion potential and have negligible global warming potential. Lee and Su (2002) conducted an experiment study on the use of isobutene as refrigerant in domestic refrigerator. The performance was comparable with those of CFC-12 and HCFC-22 was used as refrigerant.

Commercial fridge and freezer units, which go by many other names, were in use for almost 40 years prior to the common home models. They used toxic gas systems, which occasionally leaked, making them unsafe for home use. Practical domestic refrigerators were introduced in 1915 and gained wider acceptance in the United States in the 1930s as prices fell and non-toxic, non-flammable synthetic refrigerants such as Freon or R-12 were introduced. It is notable that while 60% of domestics in the US owned a refrigerator by the 1930s, it was not until 40 years later, in the 1970s, that the refrigerator achieved a similar level of penetration in the UK.

Refrigerant selection involves balancing conflicting requirements such as: ability to transfer heat, chemical stability, and compatibility with compressor lubricants, flammability, and toxicity. Akash and Said (2003) studied the performance of diverse refrigerant from local market (30%propane, 55% n-butane and 15% isobutene by mass) as an alternative refrigerant for CFC-12 in domestic refrigerator with masses of 50g, 80g and 100g. The result showed that a mass charge of 80g gave the best performance. Scientist and researcher are searching the environment benign refrigerant for the domestic refrigerator and freezer. Finally we decide to choose the diverse refrigerant as an alternate source of HFC-134.

EXPERIMENTAL SETUP AND TEST PROCEDURE

This section provides a description of the facilities developed for conducting experimental work on a domestic refrigerator. The technique of charging and evacuation of the system is also discussed here. Experimental data collection was carried out in the research laboratory of our institution. The experimental setup of the test unit and apparatus is shown in the Fig. 1.

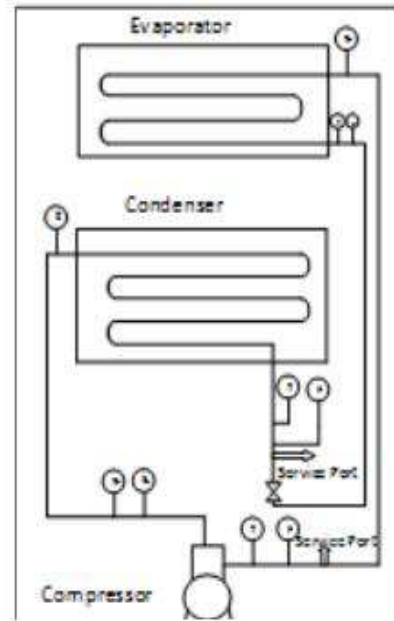


Fig. 1: Experimental Setup of the Investigation Unit and Apparatus & Fig. 2: Schematic Diagram of the Investigation Unit and Apparatus

Experimental Methodology

The experimental setup of the domestic refrigerator used in the experiment is shown in Fig 1. The domestic refrigerator consists of an evaporator, wire mesh air-cooled condenser and hermetically sealed reciprocating compressor. The 165 liters domestic refrigerator of tropical class originally designed to work with HFC134a was taken for this study. The refrigerator was instrumented with one pressure gauge at the inlet of the compressor for measuring the suction pressure, one temperature sensor mounted at inside the refrigerator (freezer) compartment. As per the refrigerator manufactures recommendation quantity of charge requirement for HFC134a was 100 g. In the experiment, refrigerant charge is 10% higher due to the presence of instruments and connecting lines etc. To optimize the diverse refrigerant charge, the refrigerator is charged with 80g.

The refrigerator was charged with 110 g of HFC134a and the base line performance was studied. After completing the base line test with HFC134a, the refrigerant was recovered from the system and charged with 80g of diverse refrigerant and the performance was studied. The refrigerant charge requirement with hydrocarbons is very small due to their higher latent heat of vaporization. During the experimentation the atmospheric is maintained at $28 \pm 2^{\circ}\text{C}$. The experimental procedures were repeated and take the reading from the various modes. Service port is installed at the inlet of expansion valve and compressor for charging and recovering the refrigerant is shown in Figure. Digital Temperature Indicator was used to measure the inside freezer temperature.

Test Procedure

Experimental system was evacuate with the help of vacuum pump to remove the moisture and charged with the aid of charging system. The temperature inside the chamber was maintained at 25°C and 28°C . When the temperature and humidity inside the chamber was at steady state, the experiments were started. The experiment has been conducted on the domestic refrigerator at no load and closed door conditions.

RESULTS AND DISCUSSIONS

In this research focus different comparisons of the performance parameter of the refrigerants and energy consumption by the refrigerator was discussed. This investigation deals with diverse refrigerant (hydrocarbon mixtures of propane, butane and isobutene) in order to assess their feasibility for replacing HFC-134a in refrigeration systems by comparing their relevant parameters. The refrigerating effect is the main purposes of the refrigeration system. The liquid refrigerant at low pressure side enters the evaporator. As the liquid refrigerant passes through the evaporator coil, it continually absorbs heat through the coil walls, from the medium being cooled. During this, the refrigerant continues to boil and evaporate.

At last the entire refrigerants have evaporated and only vapor refrigerant remains in the evaporator coil. The liquid refrigerant still colder than the medium being cooled, therefore the vapor refrigerants continue to absorb heat. The experiment was performed on the domestic refrigerator purchased from the market, the components of the refrigerator was not changed or modified. This indicates the possibility of using diverse refrigerant as an alternative of HFC-134a in the existing refrigerator system. The COP of the domestic refrigerator using R-134a as a refrigerant was considered as benchmark and the COP of diverse refrigerant compared. The time versus COP is plotted at the refrigerant R-134a and diverse refrigerant (without load & different mode) in the same graph. The results displayed in Figs. 2, 3, 4 and 5 shows a progressive increase in COP as the temperature varies.

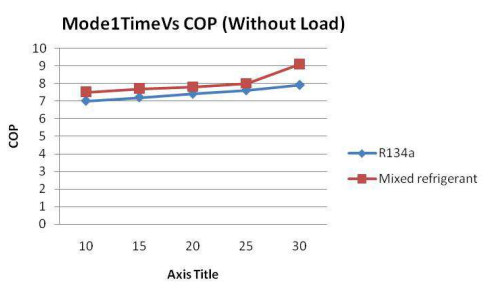


Fig. 3: Mode 1 Time Vs COP (Without Load)

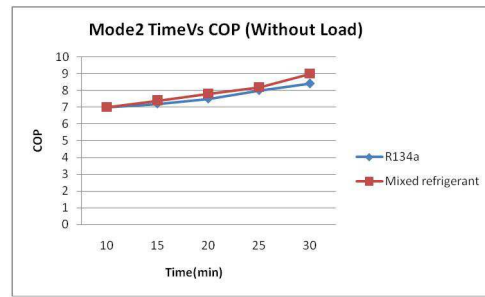


Fig. 4: Mode 2 Time Vs COP (Without Load)

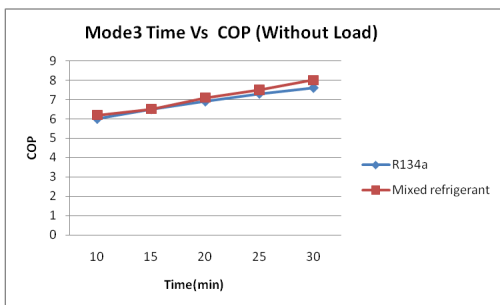


Fig. 5: Mode 3 Time Vs COP (Without Load)

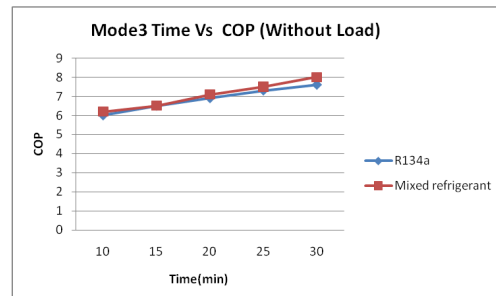


Fig. 6: Mode 4 Time Vs COP (Without Load)

The time versus COP is plotted at the refrigerant R134a and diverse refrigerant (without & different mode) in the same graph. The results displayed in Figs., 7, 8, 9 and 10 shows a progressive increase in COP as the temperature varies.

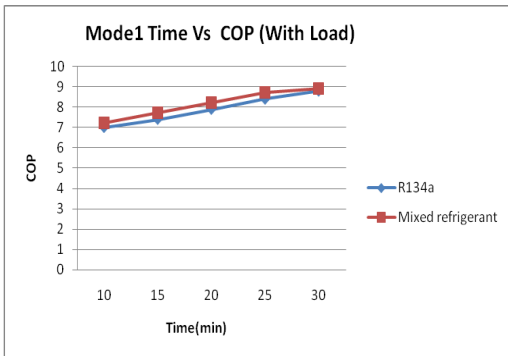


Fig. 7: Mode 1 Time Vs COP (With Load)

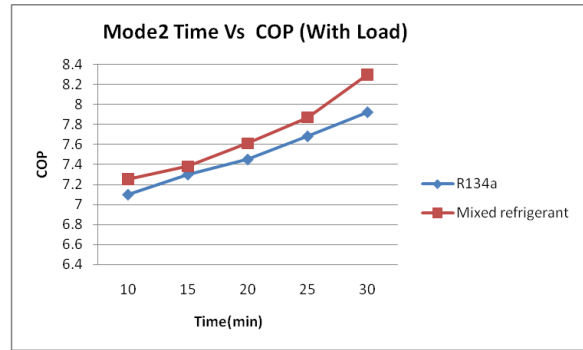


Fig. 8: Mode 2 Time Vs COP (With Load)

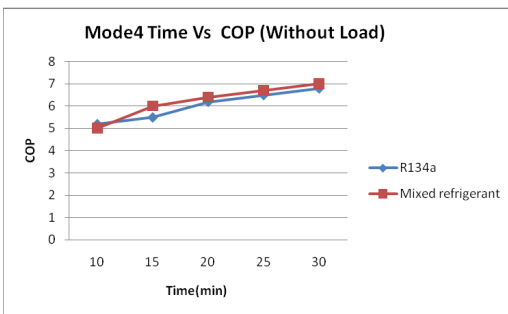


Fig. 9: Mode 3 Time Vs COP (With Load)

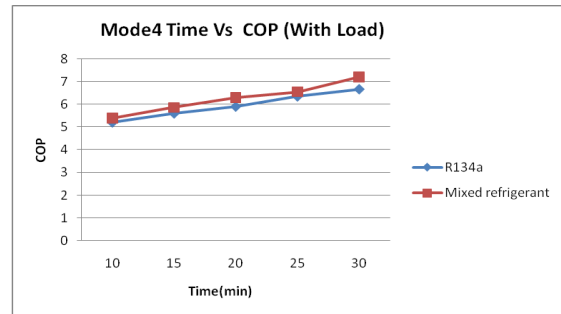


Fig. 10: Mode 4 Time Vs COP (With Load)

CONCLUSIONS

There was lot of observations were obtained in this research. This research focused and identified, it was invested an ozone friendly, energy efficient, user friendly, safe and cost-effective alternative refrigerant for HFC134a in domestic refrigeration systems. After the successful investigation on the performance of diverse refrigerants the following conclusions can be drawn based on the results obtained. This experimental investigation carried out to determine the performance of a domestic refrigerator when a propane/butane mixture is used as a possible replacement to the traditional refrigerant R134a. The used mixed (diverse) refrigerant which is locally available and comprises in various properties like: 24.4% propane, 56.4% butane and 17.2% isobutene. The performance parameters investigated are the refrigeration capacity, the evaporator temperature and the coefficient of performance (COP). The refrigerator worked efficiently when diverse refrigerant was used as refrigerant instead of R134a. The evaporator temperature reached -20°C with COP value of 6.4 and an ambient temperature of 30°C .

The results of the current work specify the successful use of this diverse refrigerant as an alternative to R134a in domestic refrigerators. The co-efficient of performance for the diverse (mixed) refrigerant is comparable with the co-efficient of performance of HFC-134a. The domestic refrigerator was charged with 140g of HFC-134a and 80g of diverse refrigerant. This is an indication of better performance of diverse refrigerant as refrigerants. The following conclusions can be elicited from our investigation

1. Each and Every mode of diverse (mixed) refrigerant yields higher COP than HFC-134a.
2. From using the diverse refrigerant in domestic refrigerator, we were observed the freezer temperature lower than that of the R134a.

3. When the evaporator temperature increases, COP will be increases and the condenser temperature decreases, COP will also increases.

ACKNOWLEDGEMENTS

We thank the Department of Mechanical Engineering, Ponjesly college of Engineering, Nagercoil, for using their laboratory tools for this work.

REFERENCES

1. Inan C, Gonul T, Tanes MY. X-ray investigation of a domestic refrigerator. Observations at 25°C ambient temperature. *Int. J Refrig.* 2003;26(2):205-213.
2. Didion DA, Bivens DB. Role of refrigerant mixtures as alternatives to CFCs. *Int J Refrig* 1990;13:163–75.
3. Gunther D, Steimle F. Mixing rules for the specific heat capacities of several HFC-mixtures. *International Journal of Refrigeration* 1997;20:235–436
4. R. Radermacher, K. Kim, Domestic refrigerator: recent development, *International journal of refrigeration* 19(1996) 61-69
5. B. A.Akash, S.A. Said, Assessment of LPG as a possible alternative to R-12 in domestic refrigerators. *Energy conversion and Management* 44 (2003) 381-388.
6. S. Devotta, A. V. Waggmare, N. N. Sawant, B.M. Domkundwar, Alternatives to HFC-22 for air conditioners, *Applied Thermal Engineering* 21(2001) 703-715.
7. 7 Joseph Sekhar, D.Mohan Lal, S. Renga narayanan, Improved energy efficiency for CFC domestic refrigerators with ozone-friendly HFC134a/HC refrigerant mixture, *International Journal of thermal Science* 43(2004) 307-314
8. Jung D, Kim CB, Song K, Park B. Testing of propane/isobutane mixture in domestic refrigerators. *Int. J Refrig.* 2000;23(7):517-527.